



WindMaster™ BAL

BUSHFIRE RATED WIND DRIVEN ROOF VENTILATOR

The WindMaster BAL ventilator is designed to exhaust heat and moisture from the roof space of a home, without the use of electrical energy. It is specifically designed for use in bushfire rated regions, from BAL12.5 up to BAL40.



HEAT REDUCTION

Removes heat from the roof space and replaces with outside air without the use of electricity.



CONDENSATION MANAGEMENT

Helps to reduce the risk of condensation-related damage to your home.



BUSHFIRE RATED

Australian made and compliant for use in homes in bushfire zones up to BAL40.

Product Specifications

Materials:	Aluminium turbine, varipitch & flashing
Varipitch Diameter:	300mm
Product Weight:	2.2kg
Applications:	Suitable for metal or tile roofs
Sparkguard:	Pre-installed in the product



Detailed warranties, technical data sheets and installation instructions are available on the website. For more information, call **1300 858 674**.



WindMaster BAL colour range:



The COLORBOND steel colour swatches shown in this flyer have been reproduced to represent actual product colours as accurately as possible. We recommend checking your selection against an actual sample. COLORBOND®, BlueScope™ and * Colour names are registered trademarks of BlueScope Steel Limited.



Why Ventilate?

Effective ventilation is an important way to create a more comfortable, healthier and energy efficient home. Removing the heat in summer and managing moisture in winter helps to create a better living environment for your family. WindMaster BAL is suitable for bushfire zones up to BAL40, and comes with an integrated ember guard mesh attached to the flashing of the product (see image on right).



Heat Reduction

Removes heat from the roof space and replaces with outside air



Energy Efficient

Helps reduce the load on air conditioning



Moisture Management

Reduce the risk of moisture-related damage



Improve Air Circulation


Replaces stale and polluted air with outside air

How ventilation works in two simple steps

1. There must be a path through which the air can be expelled, usually the ventilator.
2. There must be a path for replacement air to enter. Usually via an eave, gable, or other static vents.

Visit our website to find out more:
bradfordventilation.com.au

PRODUCT SUITABILITY: Always check product suitability and limitations of use prior to selection – refer to the Product Technical Statement (PTS) available online.

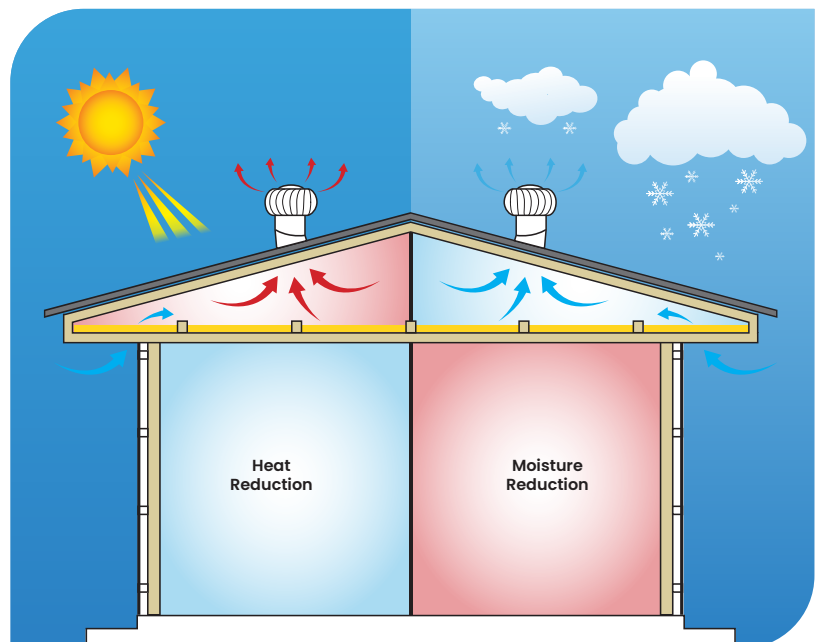

Bradford Ventilation is a business division of CSR Building Products Limited ABN 55 008 631 356.

The content of this flyer are copyright protected and may not be reproduced in any form without prior written consent of Bradford. Recommendations and advice regarding the use of the products described in this flyer are to be taken as a guide only and are given without liability on the part of the company or its employees. We reserve the right to change product specifications without prior notification, please refer to the Bradford website for the latest revision of this document. The purchaser should independently determine the suitability of the product for the intended use and application.

